


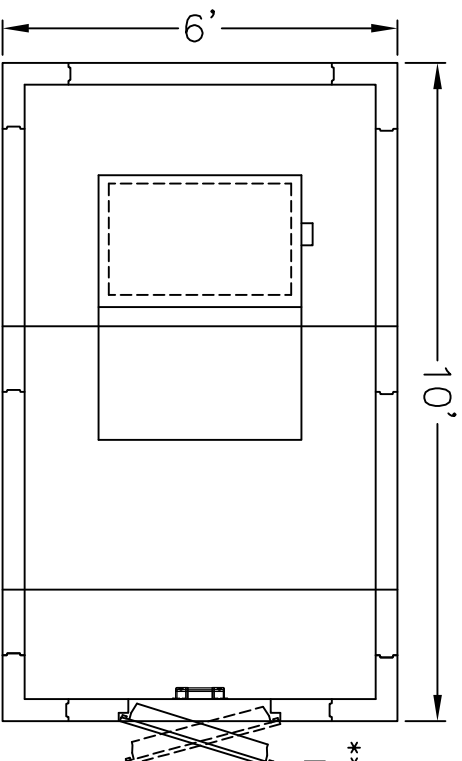

****CAPSULE PAK™
LOCATION MAY VARY**

WALK-IN HEIGHT

- ☐ **7'4"** (LESS FLOOR) (STANDARD)
- ☐ **7'7"** (WITH FLOOR) (STANDARD)

LOCATION

- ☐ **INDOOR**
- ☐ **OUTDOOR**

TEMPERATURE

- ☐ **35° F**
- ☐ **-10° F**

REFRIGERATION TYPE

- ☐ **CEILING CAPSULE PAK™** (STANDARD)
- ☐ **REMOTE**
- ☐ **NONE**

DOOR SWING

- ☐ **LEFT (SHOWN)**
- ☐ **RIGHT (DASHED)**

DOOR OPENING WIDTH

- ☐ **26"** (STANDARD)
- ☐ **30"**
- ☐ **36"** (NOT AVAILABLE ON 6'7" HEIGHT)

PLEASE RETURN THE APPROVED DRAWINGS AS SOON AS POSSIBLE TO PREVENT ANY DELAY IN FABRICATION.

☐ APPROVED

☐ APPROVED AS NOTED


☐ NOT APPROVED—RESUBMIT

SIGNED _____


DATE _____

IMPORTANT:
CHANGES MADE AFTER THE PRINT APPROVAL MAY INVOLVE ADDITIONAL CHARGES AND THE POSSIBILITY OF A REVISED SHIPPING DATE.

AVAILABLE DOOR LOCATIONS (CHECK ONE)

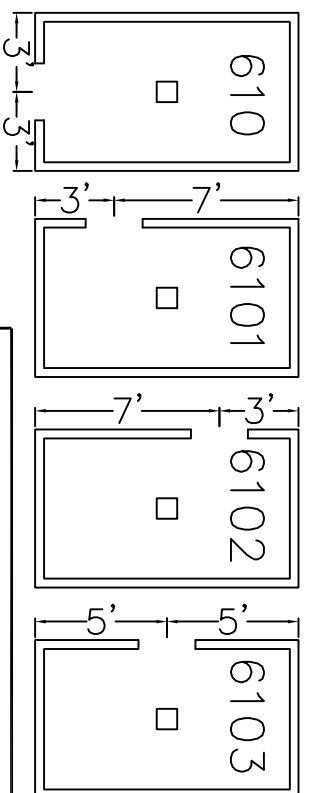

BUILDING CEILING

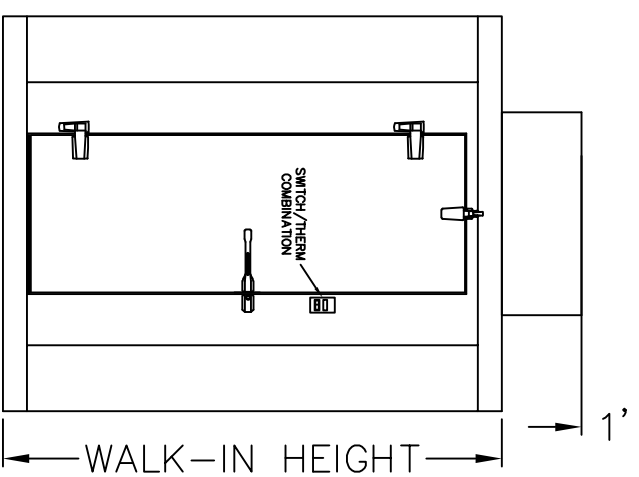

VIEW — A —

****One foot of clearance is needed between the top of the Capsule Pak™ refrigeration system and the building ceiling. Please refer to page 2 of the Capsule Pak™ specification sheet located on the Nor-Lake website for specific dimensions**

REFRIGERATED SOLUTIONS GROUP		DRN BY: KB	APP BY:
DESCRIPTION: KOLD LOCKER/QUICK SHIP		DATE: 9/6/17	SC: NTS
SIZE: 6'0"x10'0"		#: KL--610	

REV (B DEVINE) – 2/19/2025
REV (B DEVINE) – 9/23/2020